


ROOM ELEVATION VIEW

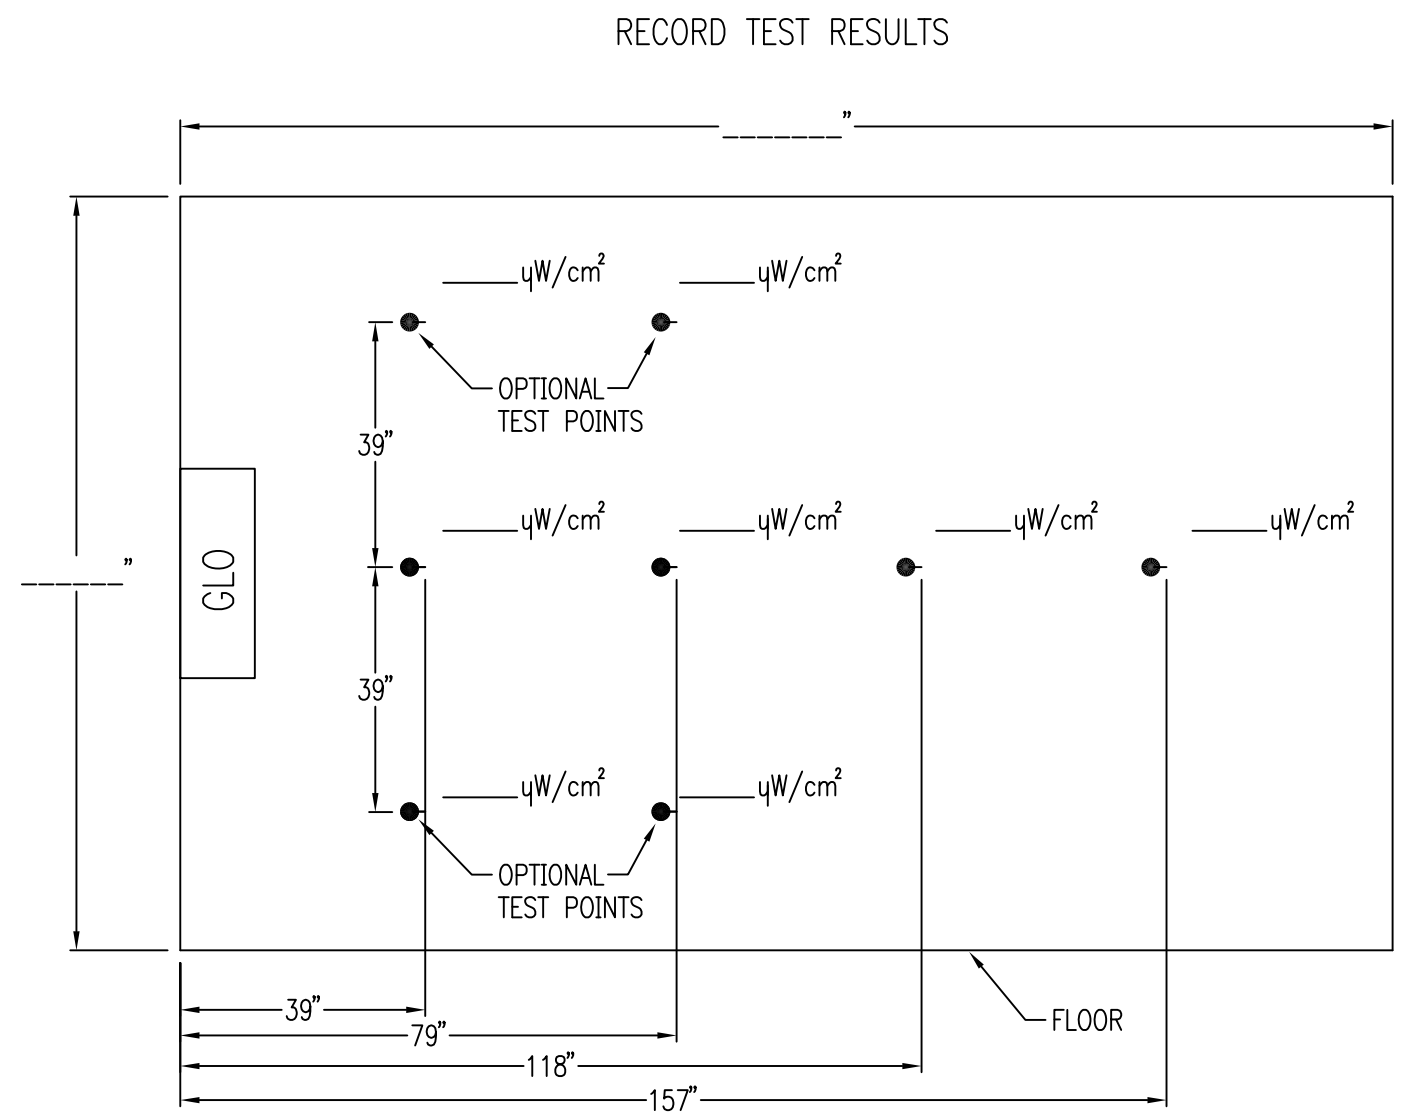

RECORD TEST RESULTS

ROOM PLAN VIEW

- NOTES:
1. REFER TO PRODUCT IOM FOR INSTALLATION DETAILS.
  2. FIXTURE BOTTOM MUST BE MOUNTED 7 FEET (84") OR HIGHER.
  3. CAUTION: ALWAYS WEAR SAEFTY GLASSES WHEN TESTING.
  4. TEST FOR UV-C AT 66"H - MUST BE BELOW 0.20uW/cm<sub>2</sub>
  5. CAUTION: DO NOT OPERATE FIXTURE WITHOUT BAFFLES SECURED.
  6. CAUTION: DO NOT LOOK INTO A LIT FIXTURE AT ANY TIME.
  7. CAUTION: TURN OFF AND UNPLUG FIXTURE BEFORE SERVICING.
  8. CAUTION: WEAR GOGGLES AND A FULL FACE MASK WHEN WORKING AROUND THIS UNIT.
  9. CAUTION: DO NOT LET ANY LIGHT STRIKE YOUR EYES WHEN DE-ENERGIZING.

DATE:	
FACILITY:	
ADDRESS:	
CITY, STATE, ZIP:	
GLO MODEL:	
GLO LOCATION: *	
GLO CONFIRMED MOUNTING HEIGHT:	
TESTER NAME:	
RADIOMETER MODEL:	
NOTES:	

\* IT IS RECOMMENDED THAT PHOTOS BE TAKEN TO DOCUMENT GLO INSTALL

0	5/6/2020	FIRST ISSUE
Rev	Date	Description
<b>UVR</b> UV RESOURCES		
Description: GLO COMMISSIONING FORM		
PN: n/a		
Rev: 0	Date: 5/6/2020	Dwg No. 98000179
		1 of 1